


Fire Hydrant in Reinforced Soil Zone

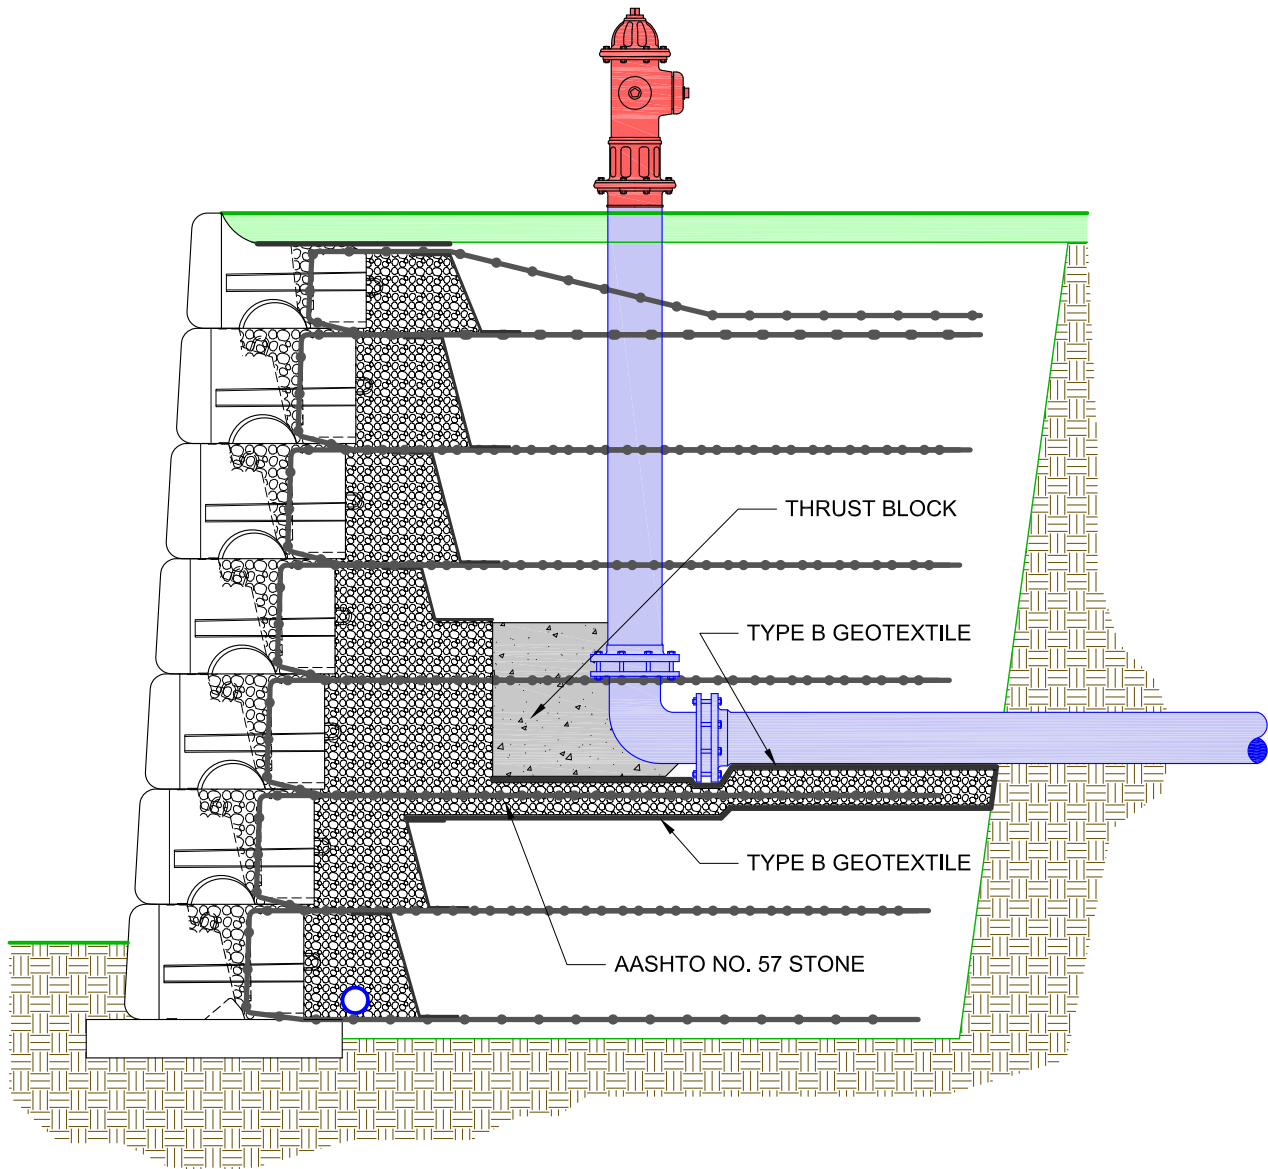

1. INSTALL HYDRANT CONCURRENTLY WITH WALL CONSTRUCTION PER SITE PLAN REQUIREMENTS.
2. INSTALL GEOGRID STRIPS AROUND RISER.
3. DRAINAGE BLANKET EXTENDS TO BACK OF REINFORCED SOIL ZONE.
4. WIDTH OF DRAINAGE BLANKET IS 3' AND THICKNESS IS 6".
5. DIVE GEOGRID STRIP DOWN UNDER DRAINAGE BLANKET AS NEEDED.
6. INSTALL AASHTO NO. 57 STONE BETWEEN THRUST BLOCK AND RED-ROCK PC BLOCKS.

This drawing is for reference only. Determination of the suitability and/or manner of use of any details contained in this document is the sole responsibility of the design engineer of record. Final project designs, including all construction details, shall be prepared by a licensed professional engineer using the actual conditions of the proposed site.

DRAWN BY:	JRJ
APPROVED BY:	JRJ
DATE:	06-22-2015
SHEET:	1 of 1

TITLE:	Fire Hydrant in Reinforced Soil Zone
FILE:	6 Fire Hydrant in Reinforced Soil Zone 062215.dwg

REDI-ROCK®
05481 US 31 SOUTH, CHARLEVOIX, MI 49720
(866) 222-8400 ext 3010 • engineering@red-rock.com
www.red-rock.com